


## Expansion & Contraction

When duct temperature variations are anticipated during the installation of Carlon P&C<sup>®</sup> Duct and Telephone Duct, allow extra duct footage at each tie-in for contraction. Terminated duct runs should be covered with backfill from tie-in point toward the end of the duct run. If the trench must be left open, don't terminate the run. All plastic duct may expand or contract as concrete is poured and cured. When placing concrete encasement, always encase from one end of the duct

section toward the other end of the section, to allow the free end to move. Never encase from each end of the section toward the center.

The coefficient of thermal expansion of Carlon P&C Duct and Telephone Duct is  $3.30 \times 10^{-5}$  in/in/°F. The following chart indicates what expansion or contraction can be expected at various temperature changes.

### Expansion/Contraction Chart

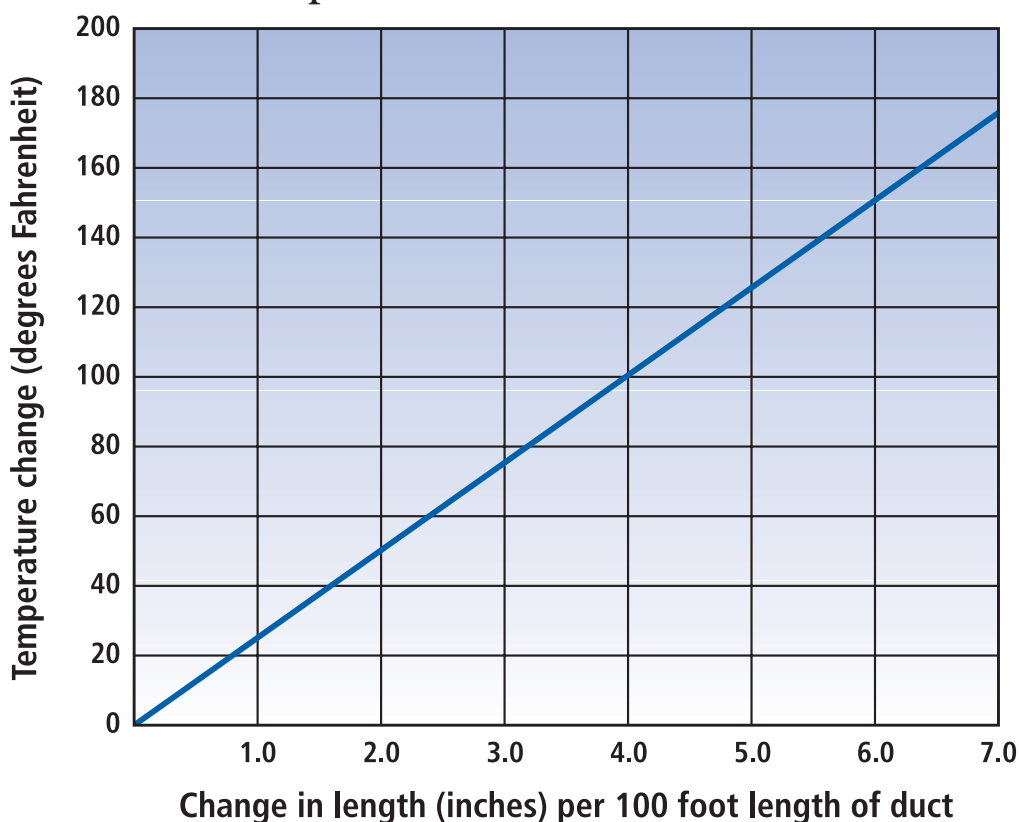

## Bridge Crossings and Exposed Applications

Type D Telephone Duct is designated specifically for use in bridge crossings and exposed applications. Using the expansion/contraction chart, calculate the number of expansion joints required. Expansion joints provide a 6" allowance for expansion/contraction. Utilize one expansion

joint for each 100 feet of exposed length for most installations. The duct should be free to move during expansion/contraction; the barrel should be securely clamped and the piston should be aligned properly with the barrel for easy movement.